


William N. Lamarre Concrete Products, Inc.


H2O 3-COMPARTMENT COMMERCIAL GRADE TUNNEL TANK

10,000 WQT Gal Capacity

Drawing Not to Scale

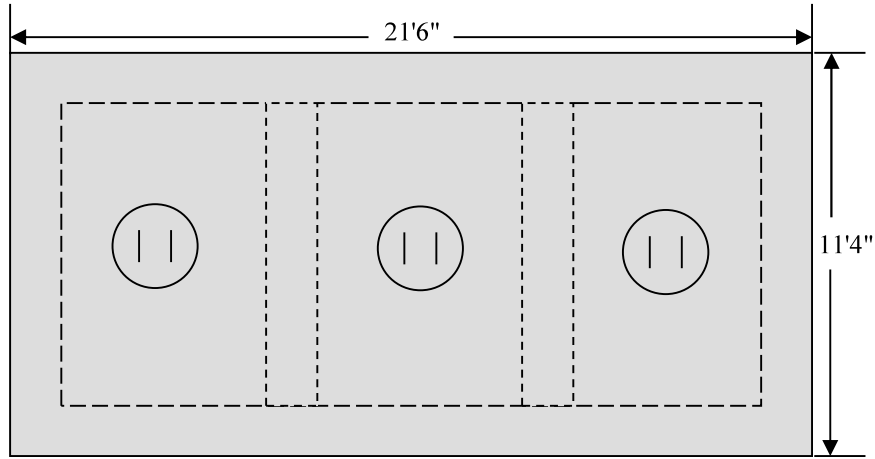

TOP VIEW-TOP
3 CLEANOUTS - 26" DIAMETER or
to Contractor Specifications

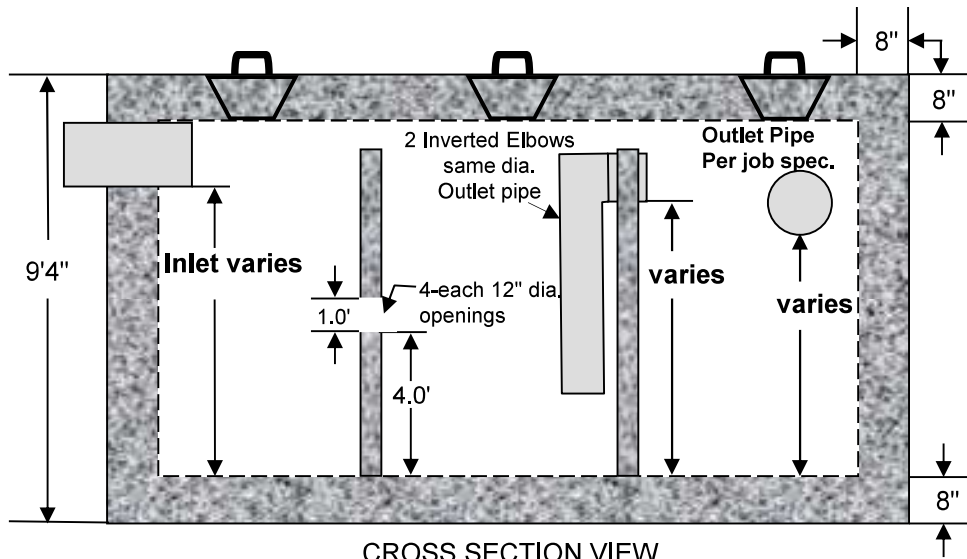

CROSS SECTION VIEW
TAPERED CROSSMEMBERS

Notes

1. Concrete strength f'c 5000PSI@28 days. Density 150 PCF.
2. Cement, Portland Type II or III, ASTM C150-81
3. Admixtures, air & plasticizers per ASTM C233-82
4. Reinforcement per ASTM C1227-latest revision
5. Design Loading AASHTO HS20-40
6. Construction joints sealed with butyl rubber
7. Design conforms to 310 CMR 15.00, Mass Title V regs. for septic tanks
8. Access & Piping per job specs.